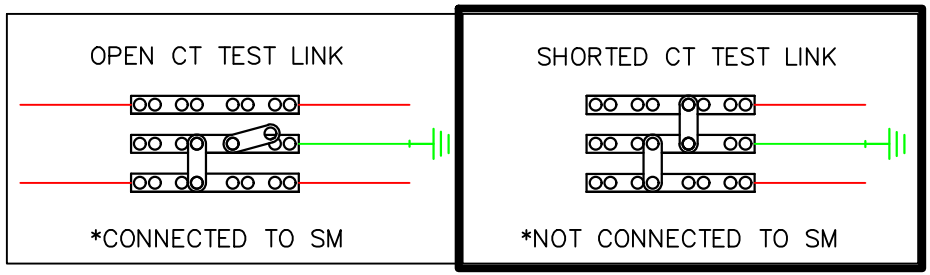

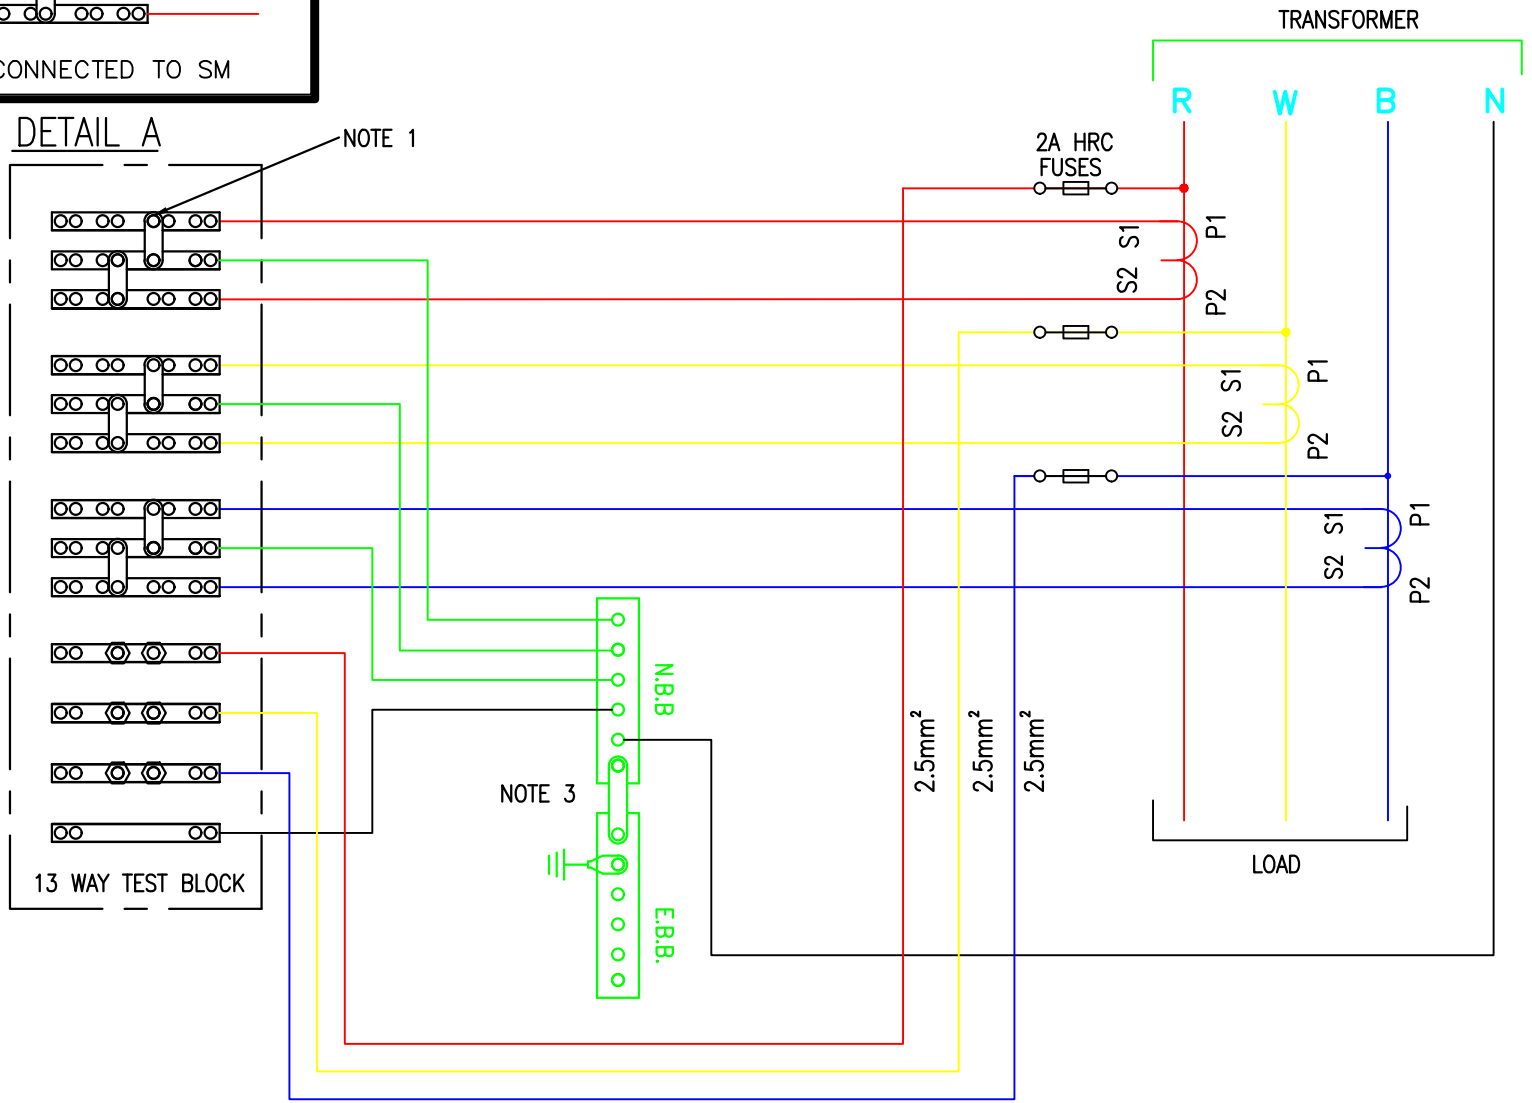

NOTE 1: CT STAR POINT SHALL BE TOWARDS THE LOAD. CT STAR POINT IS ADJUSTABLE USING SHORTING LINKS. (SEE DETAIL A)

NOTE 2: ANTENNA TO BE MOUNTED OUTSIDE THE TRANSFORMER STEEL ENCLOSURE

NOTE 3: FIT EARTH AND MAIN NEUTRAL TAG

NOTE 4: THIS DRAWING REPRESENTS TEST LINKS STATE IF NOT CONNECTED TO SMART METER.

WARNING: CT LINKS MUST BE SHORTED IF REMOVING SM.

Rev	Description	DRAWING ORGN	DSN	DRN	CHK	APPROVED BY	DATE
A	ORIGINAL ISSUE	WEL	BA	JA	BA	BO	10.23

GENERAL – METERING UNIT

CT METERING WITH 13 WAY TEST BLOCK
THREE PHASE MEN TRANSFORMER

SCALE: NTS

Drawing Number: GEN–MU–WD–200B

Issue: A

ORIGINAL

Designed:	Ben Albany
Drawn:	Johann Alcartado
Checked:	Ben Albany
Approved:	Brabbyn Osburn
Issued Date:	13/11/2024

WEL NETWORKS
Best in Service, Best in Safety